

## **ANNEXURE M**



**Tshawe Infrastructure Technologies**

Civil & Structural Eng, Project Management & Capacity Building

**SERVICES REPORT**

**FOR**

**PORTION 159 OF FARM DIEPKLOOF 319-IQ**

**ADJACENT THE SOWETO EMPOWERMENT ZONE**

**MARCH 2019**

REPORT PREPARED FOR:  
TURNING POINT PROJECT  
MANAGEMENT

Prepared by Tshawe Infrastructure Technologies  
Contact Person: Mr. A Mbonani  
Tel No.: 087 625 0487  
Email: [allanmbonani@yahoo.com](mailto:allanmbonani@yahoo.com)

Tel: 087 625 0487 email: [tshawe@tshawe.co.za](mailto:tshawe@tshawe.co.za)  
585 Mendelson Street, Constantia Park  
P.O. Box 11416, Maroelana 0161  
Directors: P. Mali B-Tech Civil Eng. Pr. Tech (Eng.), C.I. Monkoe B-Tech Civil Eng. (Structural)  
Associate Directors: I.N. Kholokholo



## CONTENTS

1. INTRODUCTIONTERMS OF REFERENCE

2. SITE DESCRIPTION

3. POPULATION FORCASTING

4. EXISTING INFRASTRUCTURE

4.1 Water reticulation

4.2 Sewer reticulation

4.3 Road network

4.4 Storm water management and reticulation

5. CONCLUSION

Tel: 087 625 0487 email: [tshawe@tshawe.co.za](mailto:tshawe@tshawe.co.za)  
585 Mendelson Street, Constantia Park  
P.O. Box 11416, Maroelana 0161  
Directors: P. Mali B-Tech Civil Eng. Pr. Tech (Eng.), C.I. Monkoe B-Tech Civil Eng. (Structural)  
Associate Directors: I.N. Kholokholo



**Tshawe Infrastructure Technologies**

Civil & Structural Eng, Project Management & Capacity Building

## **1 INTRODUCTION AND TERM OF REFERENCE**

Tshawe Infrastructure Technologies has been assigned to assess the Engineering Infrastructure Capacity for the proposed development.

This report will address the Bulk Engineering Services available for the proposed development to be defined on completion of the worked demand study. The current and future demand capacity will be addressed:

- Water Provision and Sanitation (current and future demand)
- Stormwater and road network

The main Objectives of this reports are:

- To determine whether the existing Bulk Infrastructure will accommodate the following developments; Offices, Retail, Residential, Commercial.
- To determine the point of connections to reticulations network
- To present overall scenario and present Bulk Engineering services solutions

## **2. SITE DESCRIPTION**

The site ERF 159/319-IQ is in Diepkloof within the City of Johannesburg jurisdiction the site can be accessed via Chris Hani Road where access is currently also along Collinder Road. The proposed site is 304700.99m<sup>2</sup>(30.47Ha) currently has an existing Soweto Empowerment Zone buildings, the co-ordinates of the site are 26°15'40.68" S; 27°57'02.59" E. The site is in a developed area with existing services such as sewer network, water network, roads and storm water management.

ERF 159/319-IQ is also in close proximity to amenities such as shopping centers, medical institutions and transportation nodes.

## **3. POPULATION FORECASTING**

The area is densely populated comprising of institutional facilities, business and residential area with low to medium income, the population in Diepkloof Zone 6 (ward 24) with an estimated annual average water demand of 15 851 (kl/day) in the Diepkloof area.


Tel: 087 625 0487 email: [tshawe@tshawe.co.za](mailto:tshawe@tshawe.co.za)

585 Mendelson Street, Constantia Park

P.O. Box 11416, Maroelana 0161

Directors: P. Mali B-Tech Civil Eng. Pr. Tech (Eng.), C.I. Monkoe B-Tech Civil Eng. (Structural)

Associate Directors: I.N. Kholokholo

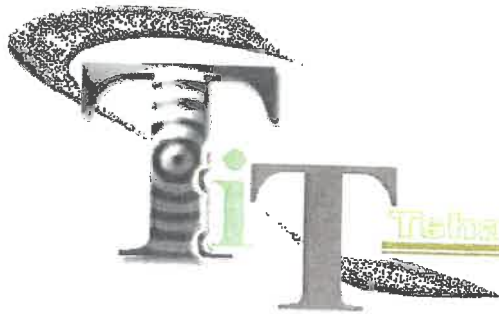

**Tshawe Infrastructure Technologies**

Civil & Structural Eng, Project Management & Capacity Building

#### **4. EXISTING INFRASTRUCTURE**

The design parameters will be incorporated into the existing services, should there be a need that the existing services will be upgraded to meet the demand of the development, while ensuring that the bulk distribution and storage infrastructure are not over exerted as a result of the designs. All applicable laws and regulations relating to public health and safety and zoning will be adhered to and the specifications of each authority will be considered during the detailed design phase. Handicap accessibility standards as prescribed by all the relevant authorities will be adhered to.

The design will meet all the requirements of all the authorities within the jurisdiction of the City of Johannesburg. The water and sanitation requirements will be in compliance with the "Johannesburg water Guidelines and standards for the design and maintenance of water and sanitation services".

##### **4.1 Water Reticulation (Current Water)**


###### **Existing Water District AADD**

<b>Feature type</b>	<b>Water pipes</b>
<b>Number</b>	<b>332810</b>
<b>Diameter</b>	<b>150mm</b>
<b>Length</b>	<b>137m</b>
<b>Elevation</b>	<b>Us 1.659.9m/Ds 1.653.5m</b>
<b>Static head</b>	<b>Us 62.4m/Ds 68.8m</b>
<b>Peak head</b>	<b>Us 52.2m/Ds 58.5m</b>
<b>Peak Row</b>	<b>2.50l/s</b>
<b>Peak Velocity</b>	<b>0.14m/s</b>
<b>System</b>	<b>Diepkloof Reservoir</b>

Tel: 087 625 0487 email: [tshawe@tshawe.co.za](mailto:tshawe@tshawe.co.za)

585 Mendelson Street, Constantia Park  
P.O. Box 11416, Maroelana 0161

Directors: P. Mali B-Tech Civil Eng. Pr. Tech (Eng.), C.I. Monkoe B-Tech Civil Eng. (Structural)  
Associate Directors: I.N. Kholokholo

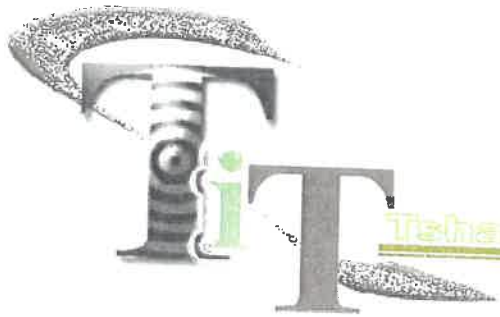

**Tshawe Infrastructure Technologies**

Civil & Structural Eng, Project Management & Capacity Building

### Water Reticulation (Future Water)

Feature type	Water pipes
Number	335452
Diameter	150mm
Length	137m
Elevation	Us 1.659.9m/Ds 1.653.5m
Static head	Us 63.8m/Ds 69.2m
Peak head	Us 42.0m/Ds 48.4m
Peak Row	1.7l/s
Peak Velocity	0.1m/s
System	Diepkloof Reservoir

Water reticulation design will be based on the current capacity in the area, the current system which the Diepkloof reservoir is supplied through a 1.7 km long 700mmØ bulk pipeline from Rand Water Connection 2179. The present AADD is 15 851 kl/day. The 700mm diameter bulk pipeline can supply the required flow rate of 1.5 X AADD 9275 (l/s) at a velocity of 0.97 m/s which is within the acceptable limit, therefore indicating that spare capacity is available. The site is serviced by a 30 Ml reservoir (Diepkloof reservoir).

The average reservoir storage, 26 X AADD, the current reservoir capacities are therefore adequate to supply the ultimate demands. Provisions for future water demand in the area have been made, the estimated future demand is based on a 5year cycle from the base line year 2009, and as such the current supply will be sufficient to meet the estimated demand of the development. The elements water distribution and storage system consist of adequate bulk water transmission systems such as bulk-storage reservoirs, intermediate-storage reservoirs and distribution networks.

Connection of the proposed developments water reticulation network to the bulk supply line will be done upon capacity approval from Johannesburg water (JW). The estimated demand for the development is calculated with the guidelines of the "Johannesburg water Guidelines and standards for the design and maintenance of

Tel: 087 625 0487 email: [tshawe@tshawe.co.za](mailto:tshawe@tshawe.co.za)

585 Mendelson Street, Constantia Park

P.O. Box 11416, Maroelana 0161

Directors: P. Mali B-Tech Civil Eng. Pr. Tech (Eng.), C.I. Monkoe B-Tech Civil Eng. (Structural)  
Associate Directors: I.N. Kholokholo

water and sanitation services” and “CSIR’s Guidelines for Human settlement planning and design”.


### **Water Connection**

There can be a water connection along Chris Hani Road and inside the proposed development area.

### **Future water demand in the area**



Directors: P. Mali B-Tech Civil Eng. Pr. Tech (Eng.), C.I. Monkoe B-Tech Civil Eng. (Structural)  
Associate Directors: I.N. Kholokholo

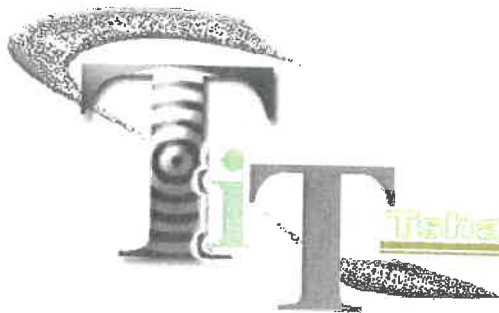

**Tshawe Infrastructure Technologies**

Civil & Structural Eng, Project Management & Capacity Building

## 4.2 Sewer Reticulation

### Sewer Reticulation (Current Sewer)

Feature type	Water pipes
Code	4-07-02-10163
Diameter	150mm
Length	78m. slope 1 in 202 (min slope)
Inverts	No data
Full velocity	0.65m/s
Capacity	11.5l/s
Max flow	0.8m/s
Spare capacity	Abs: 93.3%. Rel: 93.3%
System	Ret- Power Park

### Sewer Reticulation (Future Sewer)

Feature type	Water pipes
Code	4-07-02-10163
Diameter	150mm
Length	78m. slope 1 in 202 (min slope)
Inverts	No data
Full velocity	0.65m/s
Capacity	11.5l/s
Max flow	0.9l/s
Spare capacity	Abs: 91.9%. Rel: 91.9%
System	Ret- Power Park

Diepkloof sewer management plan falls under the Southern (Diepkloof) sub-basin, the sub-basin serves certain portion of the Diepkloof area, the sub-basin slopes in a north westerly direction and is served by the Diepkloof link outfall which originates in Diepkloof as a 300mmØ sewer. There is a 150mmØ sewer collector pipes running on the perimeter of the site with possible sewer connection points.

Tel: 087 625 0487 email: [tshawe@tshawe.co.za](mailto:tshawe@tshawe.co.za)

585 Mendelson Street, Constantia Park

P.O. Box 11416, Maroelana 0161

Directors: P. Mali B-Tech Civil Eng. Pr. Tech (Eng.), C.I. Monkoe B-Tech Civil Eng. (Structural)

Associate Directors: I.N. Kholokholo



**Tshawe Infrastructure Technologies**

Civil & Structural Eng, Project Management & Capacity Building

The 300mm $\varnothing$  collector pipe discharges waste material into the 1050mm $\varnothing$  outfall. The outfall increases to a 1657 mm $\varnothing$  sewer downstream before connecting to the BKP2 tunnel. The North Westerly outfall drains to the Bushkoppies waste water treatment works (WWTW). The Bushkoppies WWTW has a capacity of 220 Ml/day. The estimated sewer demand for the development is calculated with the guidelines of the "Johannesburg water Guidelines and standards for the design and maintenance of water and sanitation services" and the "CSIR's Guidelines for Human settlement planning and design" which will be finalized once we know what we going to be developing.

#### **4.3 Road network**

There are major roads surrounding the site, minor upgrading may be required for this proposed development mostly in the area where the traffic will enter and exit the property. The traffic flow will be analysed and the roads may need upgrading in order to meet the traffic loading. The access roads and internal roads of the development will meet the requirements of the "SANRAL Geometric Guidelines", the turning radii, design speed and vehicle dimensions will be in accordance with the manual.

The Collinder road might need to be refurbished in order to cater for the new development.

#### **4.4 Storm water management and reticulation**

An internal storm water management system will be provided for the catchment area of the Diepkloof zone 6 ERF 159/319-IQ development to drain the surface runoff from the development to the JRA storm water infrastructure. The design parameters for the proposed development will allow an integration of the internal drainage system of the development and the JRA storm water system. The surface runoff on the parking will be drained by catch pits and grid inlets, and the roof runoff will be drained by the gutters and down pipes, all of this runoff will then be discharged into the internal storm water channels (or storm water pipes) and from there the runoff will be discharged into the JRA bulk storm water system.


Tel: 087 625 0487 email: [tshawe@tshawe.co.za](mailto:tshawe@tshawe.co.za)

585 Mendelson Street, Constantia Park

P.O. Box 11416, Maroelana 0161

Directors: P. Mali B-Tech Civil Eng. Pr. Tech (Eng.), C.I. Monkoe B-Tech Civil Eng. (Structural)

Associate Directors: I.N. Kholokholo

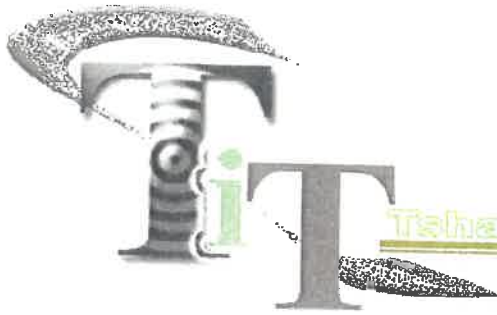

**Tshawe Infrastructure Technologies**

Civil & Structural Eng, Project Management & Capacity Building



There are existing stormwater drainage next to the proposed development.

## 5. CONCLUSION

The yield of this network may be sufficient as this area is in a developed area with storage and distribution infrastructure and future water and sewer demand allowance.


Tel: 087 625 0487 email: [tshawe@tshawe.co.za](mailto:tshawe@tshawe.co.za)

585 Mendelson Street, Constantia Park

P.O. Box 11416, Maroelana 0161


Directors: P. Mali B-Tech Civil Eng. Pr. Tech (Eng.), C.I. Monkoe B-Tech Civil Eng. (Structural)

Associate Directors: I.N. Kholokholo

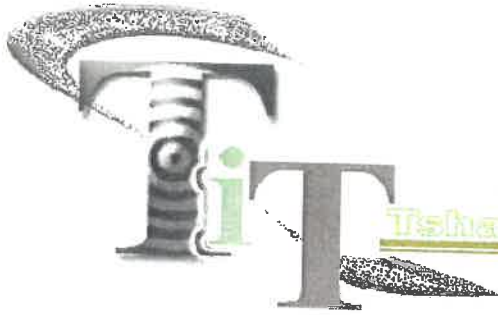

**Tshawe Infrastructure Technologies**

Civil & Structural Eng, Project Management & Capacity Building

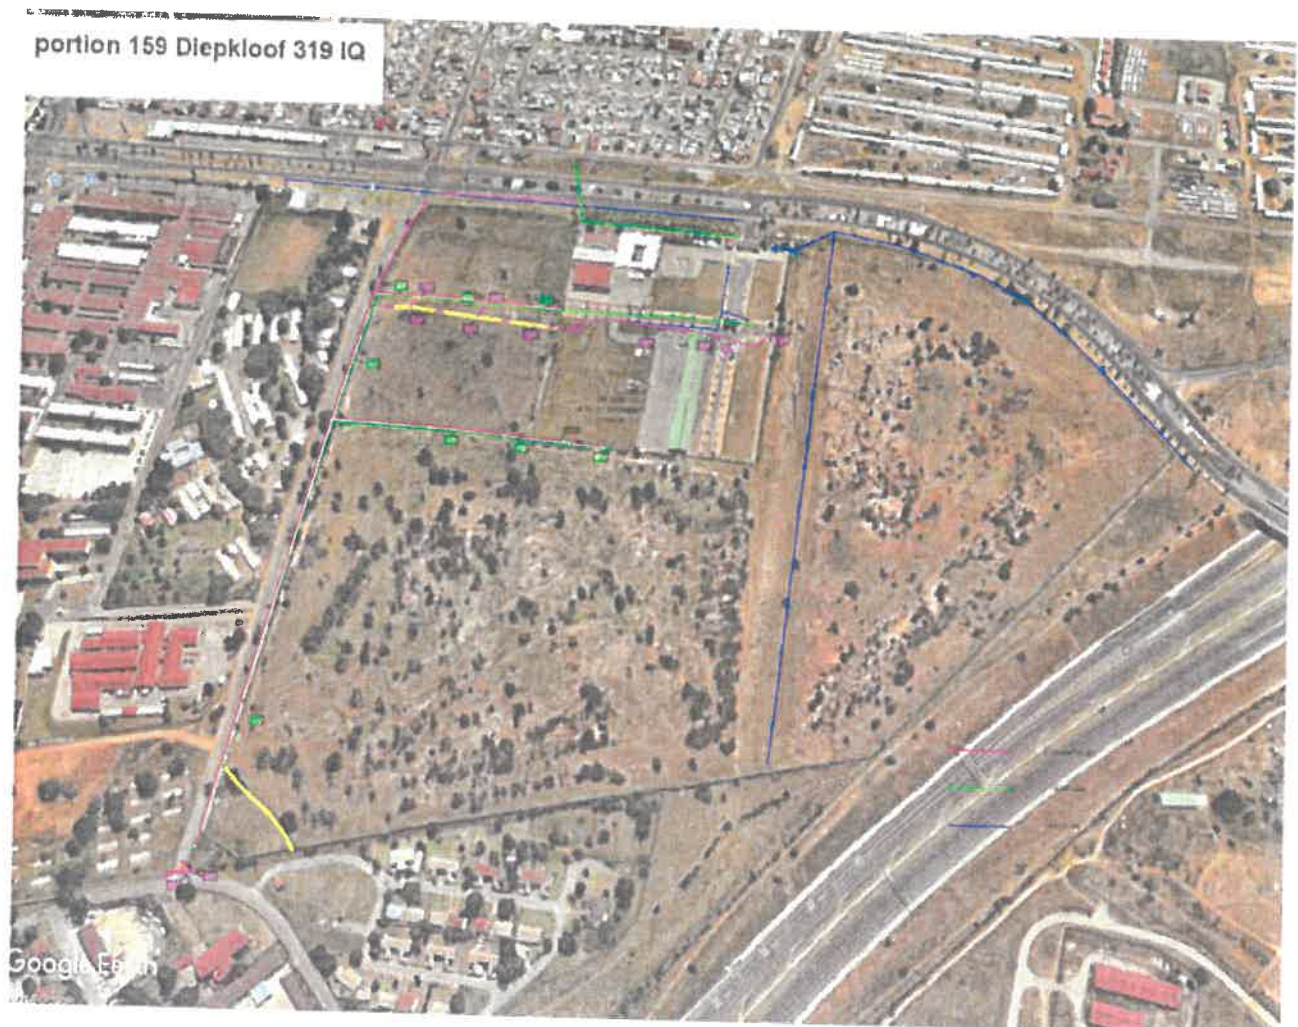

The above image shows the existing infrastructure within and around the proposed site development; sewer line (green), stormwater line (purple) and water line (blue) as per feasibility study and the survey done on site.

Tel: 087 625 0487 email: [tshawe@tshawe.co.za](mailto:tshawe@tshawe.co.za)

585 Mendelson Street, Constantia Park

P.O. Box 11416, Maroelana 0161

Directors: P. Mali B-Tech Civil Eng. Pr. Tech (Eng.), C.I. Monkoe B-Tech Civil Eng. (Structural)

Associate Directors: I.N. Kholokholo